

Hybrid Power Systems

Hybrid Power Systems are Not New



Carol Spring Mtn., AZ



Mt. Home AFB, ID



**Test Ban Treaty Monitoring,
Antarctica**



McMurdo Station, Antarctica

Hybrid Power Systems

- Hybrid power systems use local renewable resources to provide power.
- Community hybrid power systems can range in size from small household systems (100 Wh/day) to systems supplying a whole area (10's MWh/day).
- They combine many technologies to provide reliable power that is tailored to the local resources and community.
- Potential components include: PV, wind, micro-hydro, biomass, batteries, conventional generators, and direct load control.

Agricultural Water Pumping

- Livestock watering at the Bledsoe Ranch Colorado, USA
- PV, Mechanical wind and diesel backup solves problems with seasonal variations in resource



NEOS Corporation



Home Power Systems

- **Systems do not have an automated backup generator like most larger hybrids**
- **Very simple architecture:**
 - Turbine, PV, Disconnects, Batteries
 - DC Loads or AC power through an inverter
- **Primarily PV dominated for small loads, wind has potential at larger loads.**
- **In many instances a combination of PV and wind make most sense**
- **Can vary in size, power output**

Inner Mongolia, Wind/PV Home Systems



Energy Flow for All-Renewable Hybrid

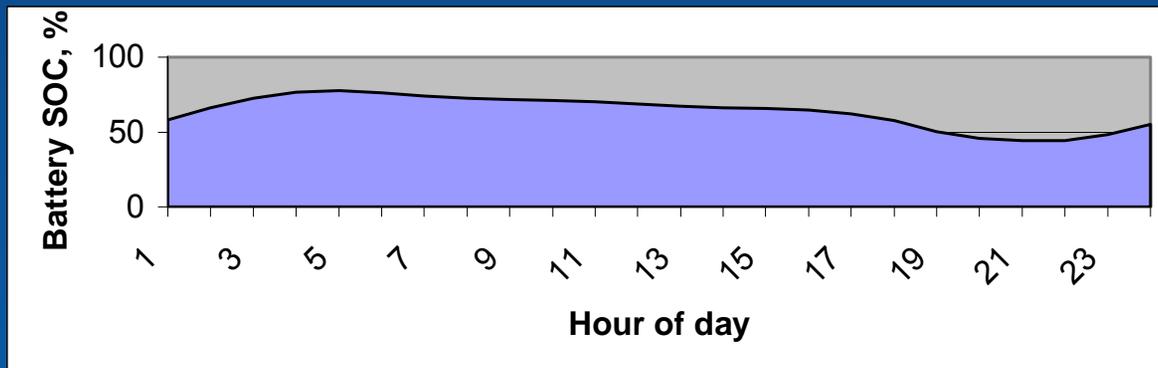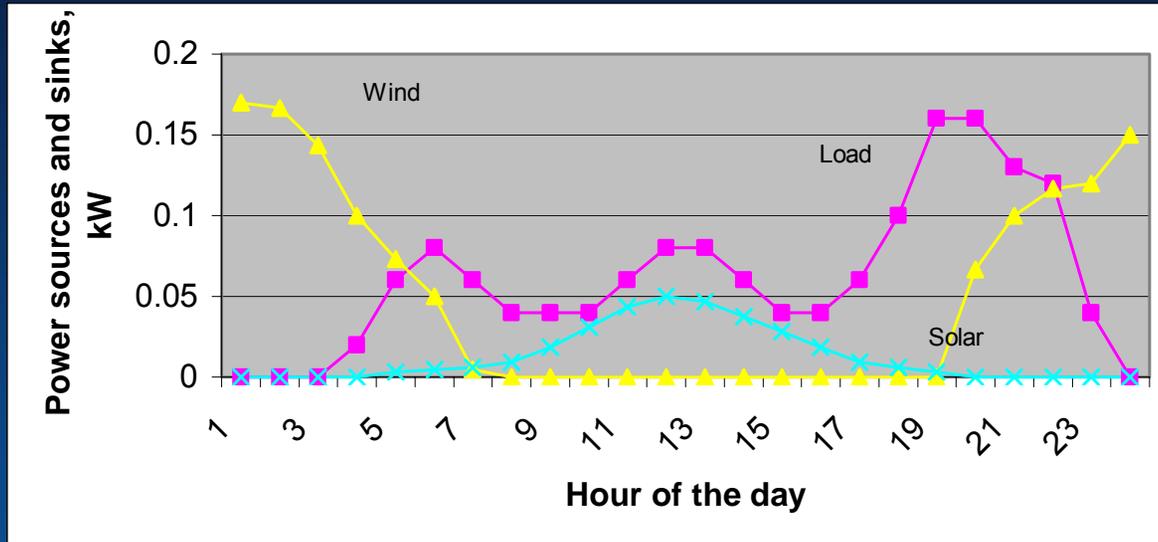

Single Home Systems/mini-grids

- Chipepte, Mexico
 - Windseeker 503
 - 1000Ah, 12V, “No maintenance” Battery Bank
 - < 100W DC Loads
- Pez Maya, Mexico
 - 2 AIR Marine 403 turbines
 - 1000Ah, 12V, “No maintenance” Battery Bank
 - 1100W inverter
 - power to a small mini-grid for homes and cottages




Pez Maya



Community-Scale Power Systems

**Centrally located and used by the whole
community or area through connection to a
common distribution system**

Typical System Architecture

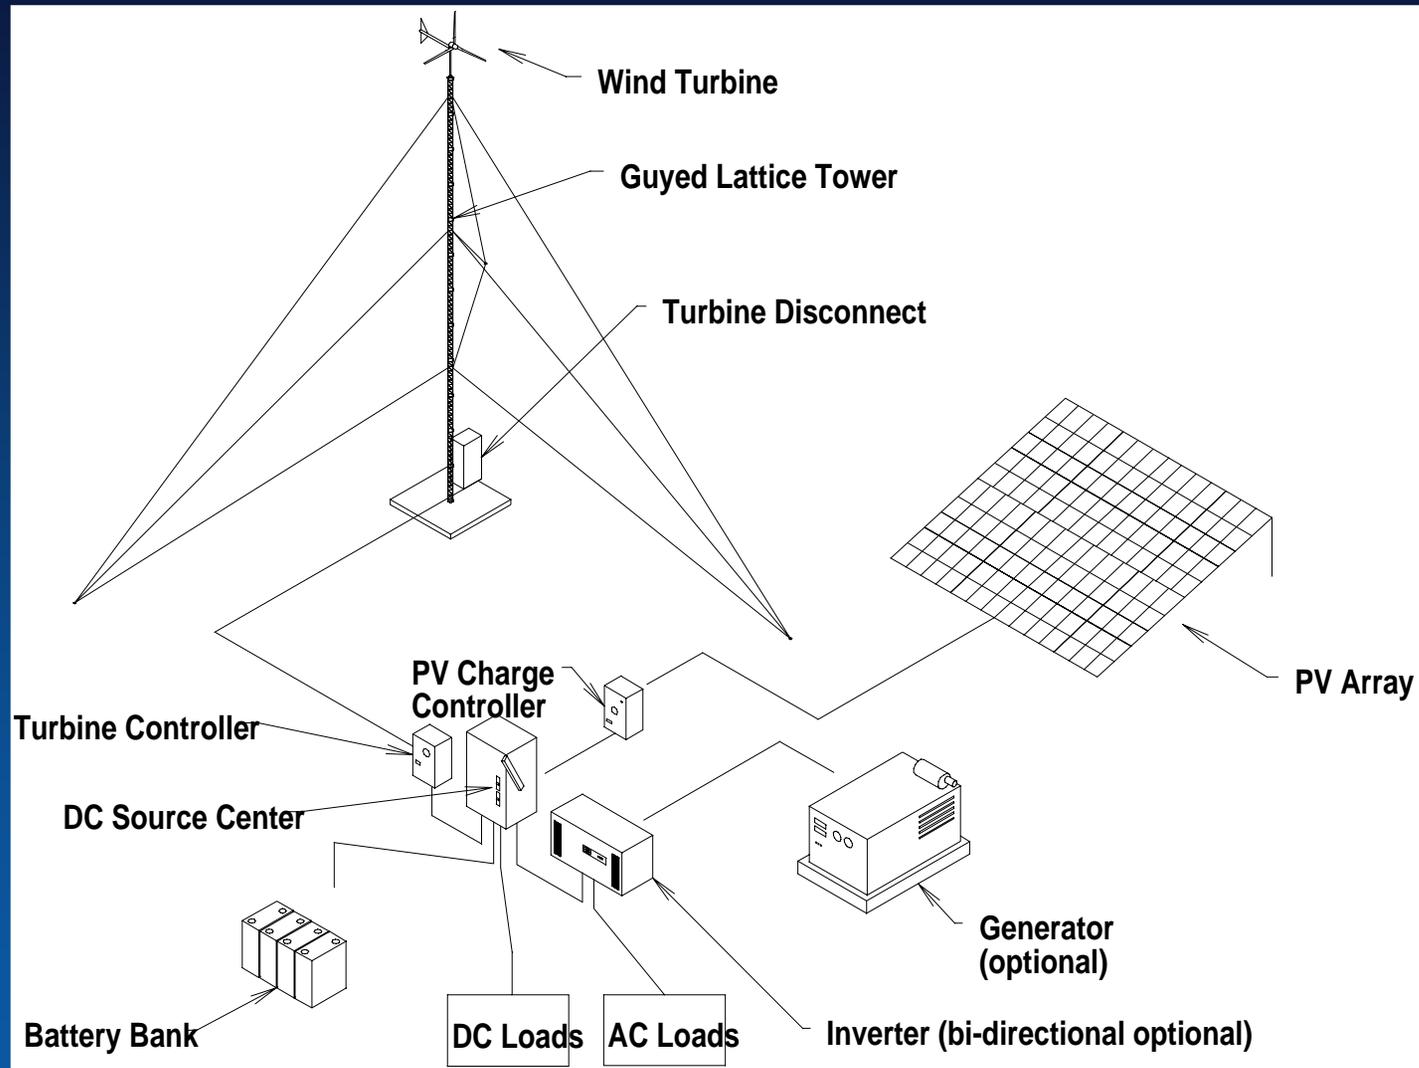

Energy Flow for Small Wind-Diesel Hybrid

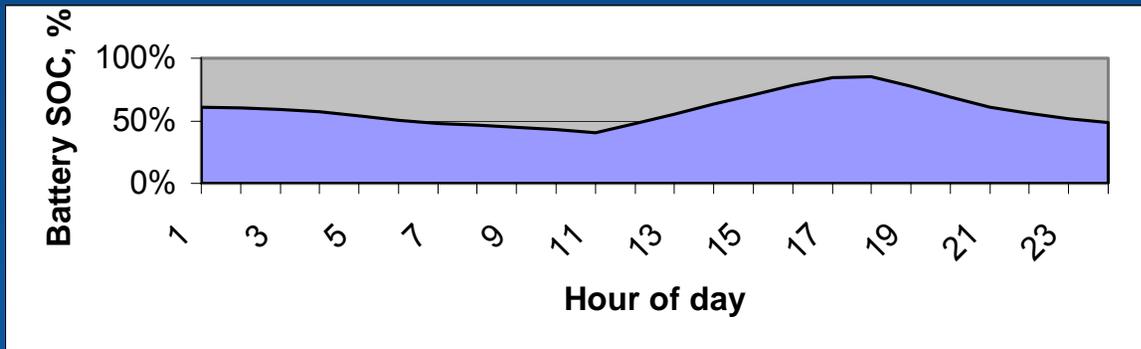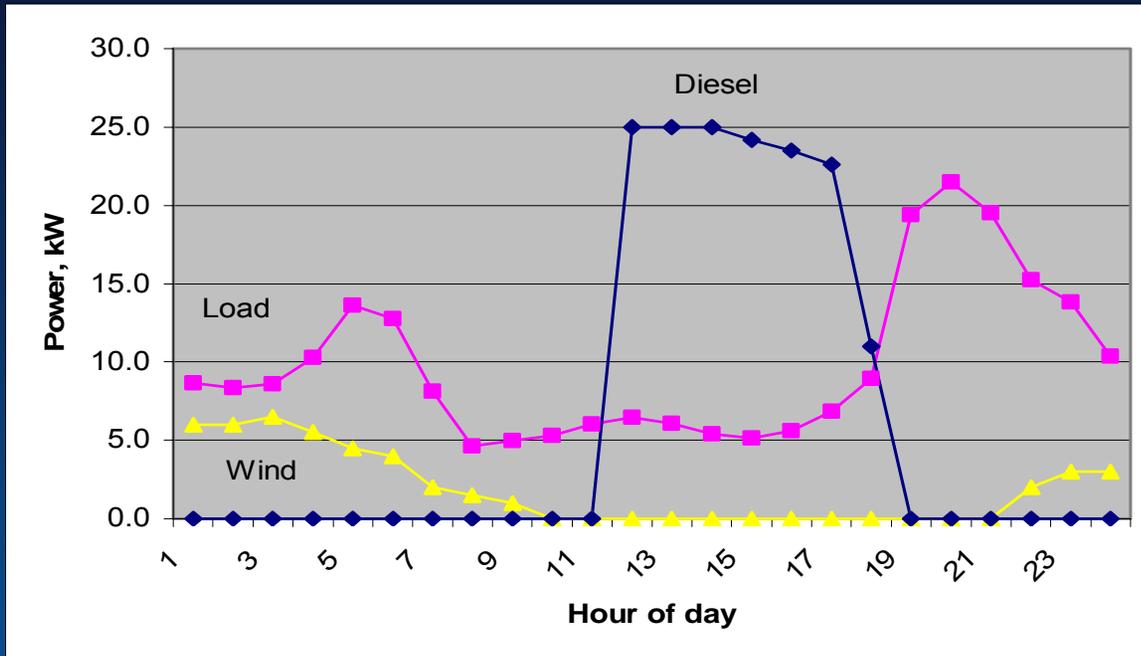

Sunwize Power System

- Whisper 3000 wind turbine
- 1.8 kW PV (Siemens)
- 5.8 kW diesel generator
- 25.6 kWh battery bank
- 2-SW4048 4kW inverters



Santa Cruz Island, California, USA

- Remote Telecommunications station
- Power System
 - PV array
 - Two wind turbines
 - No Backup generator
- Vary costly access/site visits
- Remote operation and monitoring of system



Northern Power Systems

National Parks



Farallon Island, CA,
US Fish & Wildlife Svc. (9 kW)



Sleeping Bear Dunes Nat.
Lakeshore, MI (11 kW)



Dangling Rope Marina, Lake Powell, UT (160 kW PV/Propane)

Remote Village of Xcalac, Mexico



Now Running on Diesel Only



60 kW Wind, 12 kW PV, 40 kW Inverter

Remote Village of Joanes, Brazil

Remote village the
Island of Marajo

50kW Power System

- PV array
- Four wind turbines
- Backup generator



Northern Power Systems

Power system used to support local grid

Remote Village of Campinas, Brazil



50 kW PV
50 kVA Inverter
300 kWh Batteries

Remote Village of San Juanico, Mexico

Remote fishing & tourism community of 400 people



Power System

- 17 kW PV
- 70 kW wind
- 80 kW diesel generator
- 100 kW power converter/controller
- Advanced monitoring system


Wind-Diesel Power Systems

- Larger systems with demands over ~ 100 kW peak loads up to many MW
- Based on an AC bus configurations
- Batteries, if used, store power to cover short lulls in wind power
- Both small and large renewable penetration designs available
- Large potential mature with fewer examples
- Provide conventional AC power


Wind-Diesel System Penetration Ranges

	Low	Medium	High
Peak Instantaneous	<50%	50 – 100%	100 – 400%
Annual Average	<20	20 – 50%	50 – 150 %
Commercial status	Fully utilized	Well proven Fully commercial Multiple use	System prototypes Operating
Examples	Denmark, Greece	San Clemente, CA Kotzebue, Ak Coyaique, Chile	St. Paul Wales Ak

Diesel Only Power System

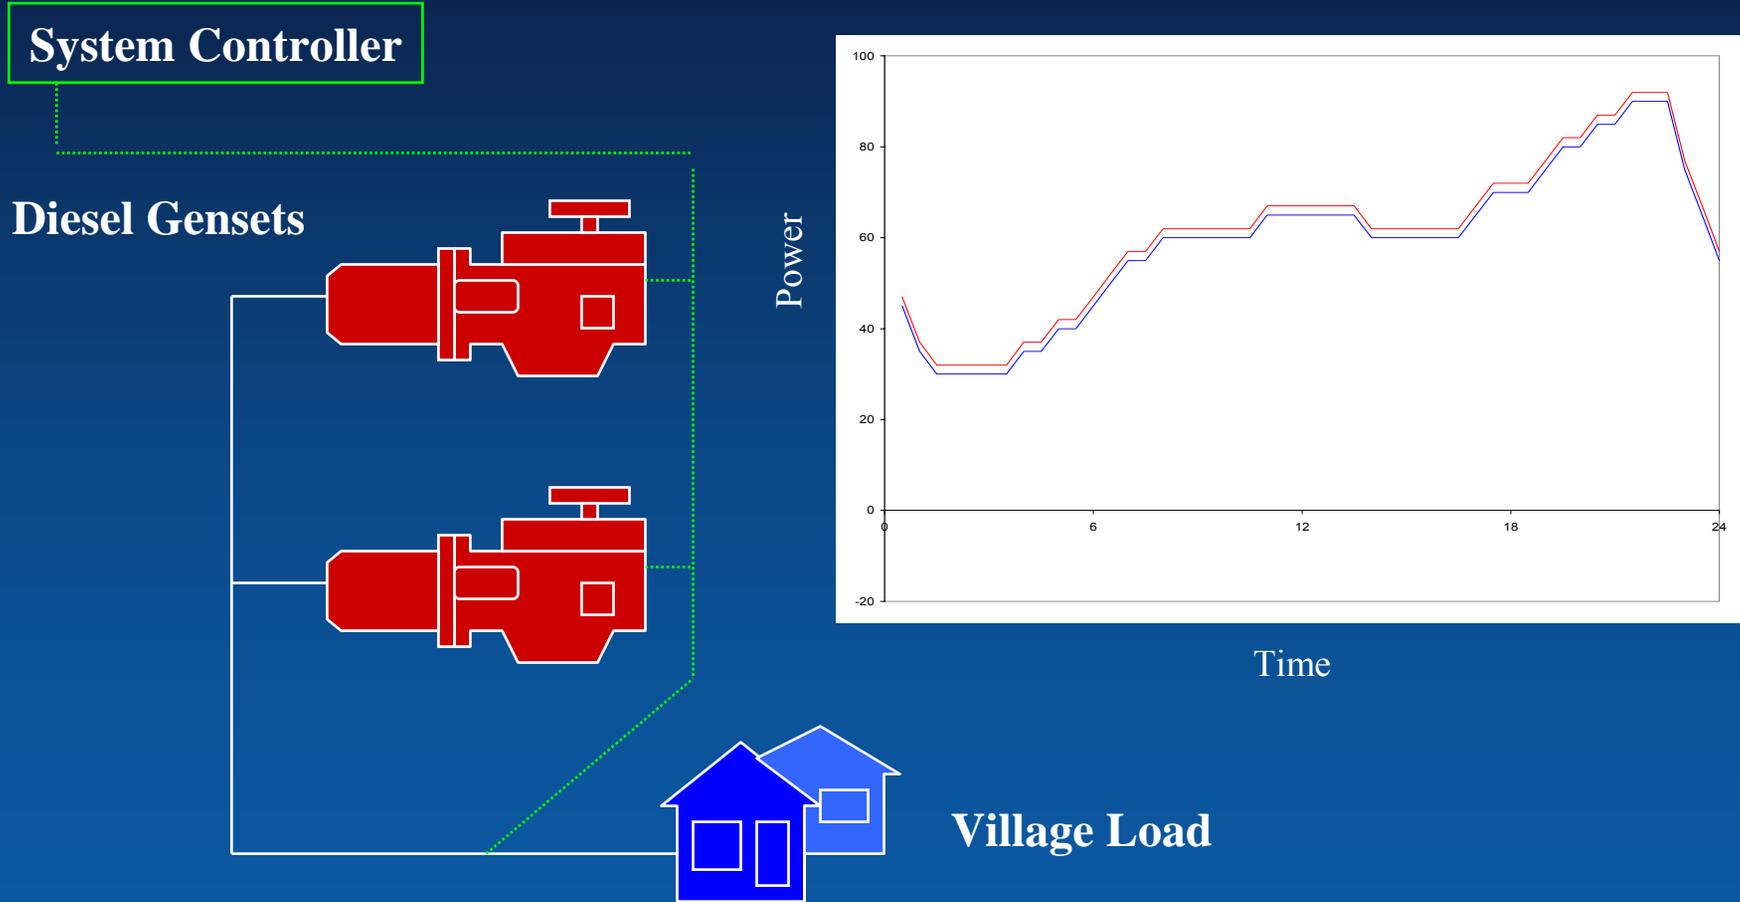


Low Penetration Wind/Diesel System

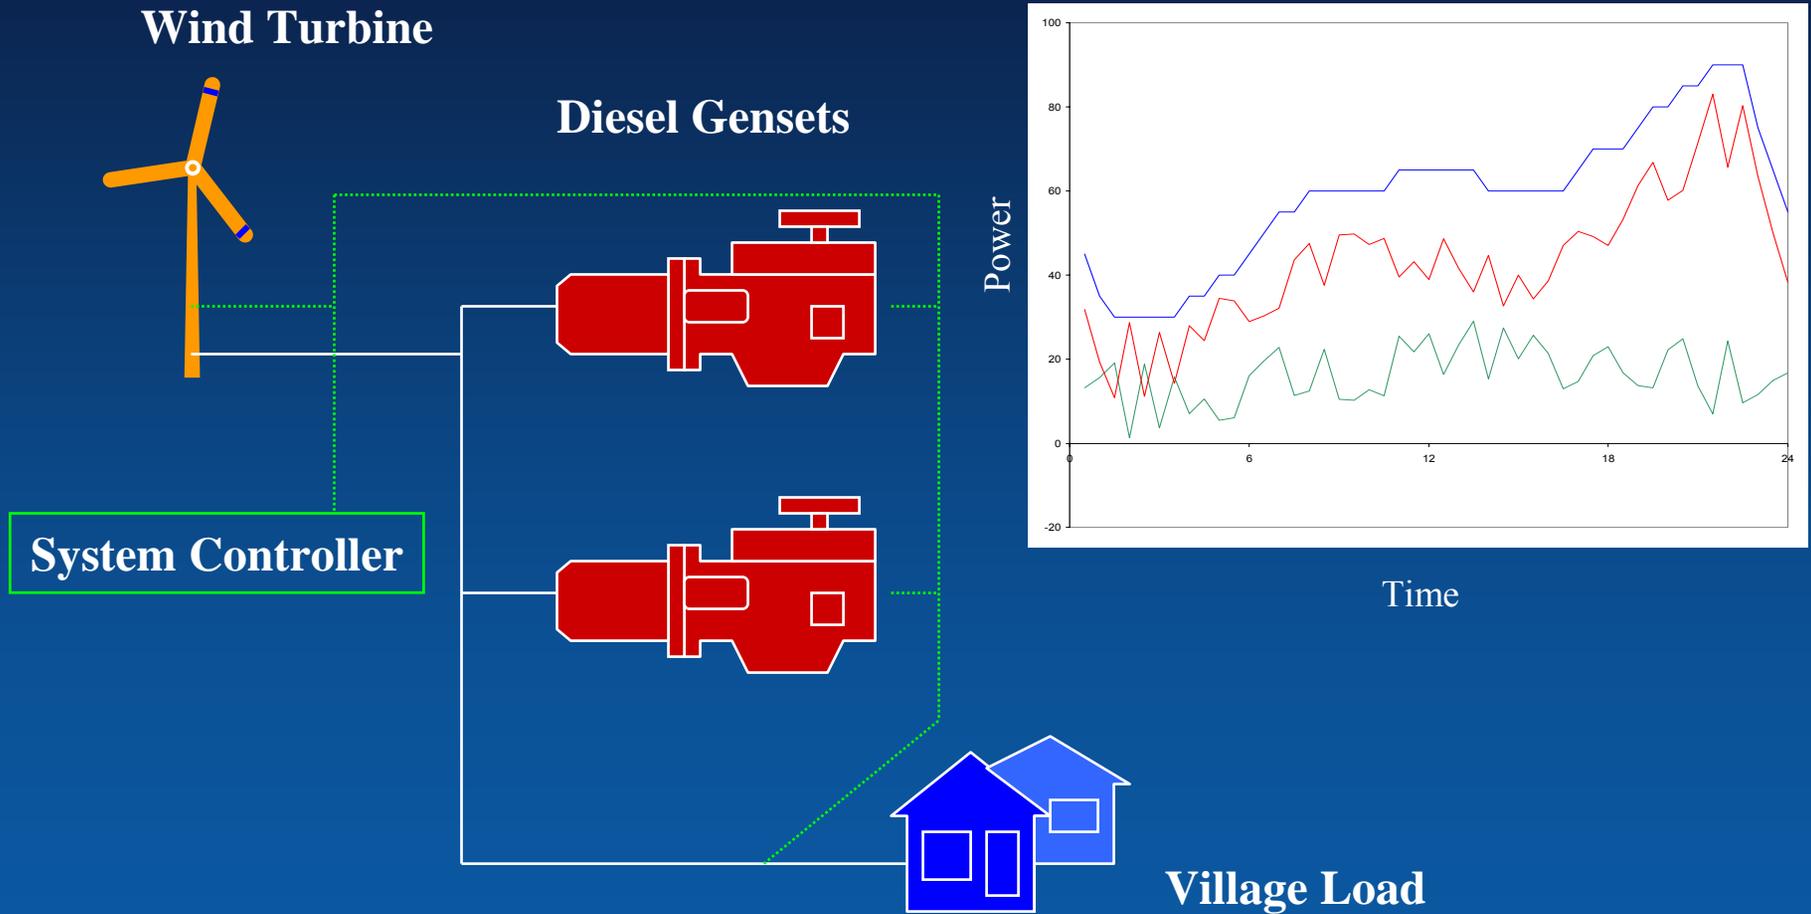

Multiple Diesel Plants with Control

In multiple diesel systems the diesels may be dispatched to take advantage of the renewable energy. Requires automatic diesel control.

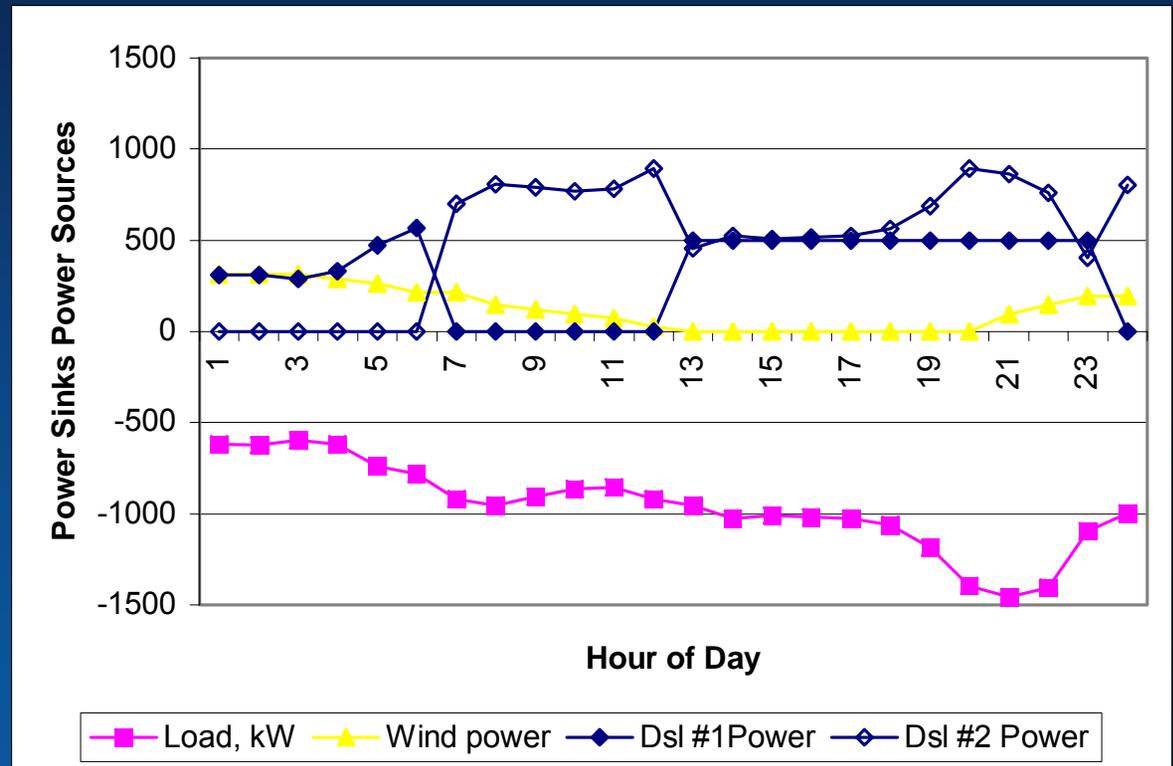

Ascension Island



Four NEG-Micon 225 kW turbines installed in 1996.

- U.S. Air Force installation on British island in mid-Atlantic ocean.
- Prime diesel generation with rotary interconnect to British 50 hertz system

Coyaique, Chile




Isolated Community
Private Utility

– 2 MW Wind, 4.6 MW
Hydro, 16.9 MW Diesel

Remote installation



High Penetration Wind Diesel System Wales Alaska

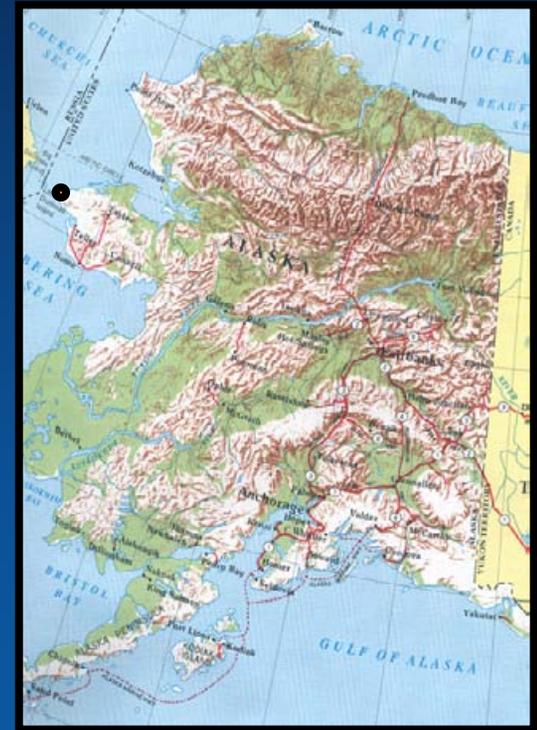

High Penetration System Wales Alaska



Wind Turbines
(Induction, Stall-Regulated)
2 X 65 KW = 130 KW




Battery Bank
240 VDC, 130 Ah
~30 kWh



Rotary Converter
156 kVA




Secondary Load Controllers



Resistance Heaters

Diesel Plant Hydronic Loop

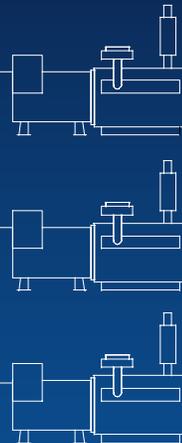

Diesel #1
142 kW

Diesel #2
75 kW

Diesel #3
148 kW




School Heating System




Primary Village Load
40-120 kW

Wind/Diesel with short term storage

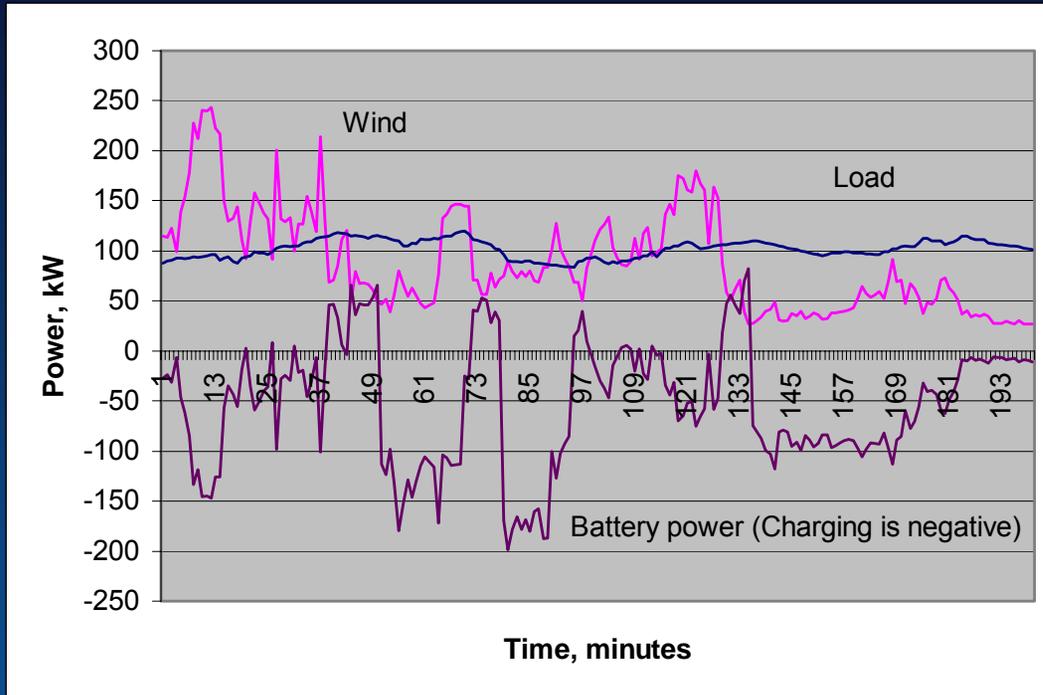

- Diesel used to provide power to system when the wind cannot cover load.
- Battery used to fill short gaps in or to start diesel

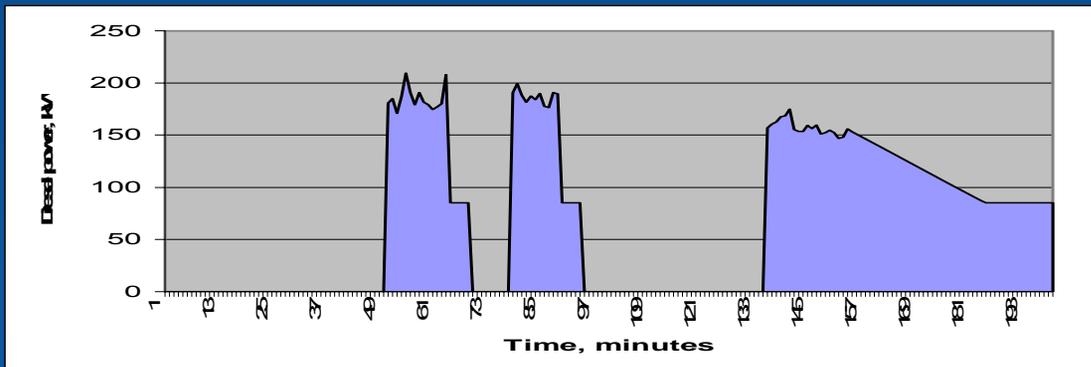


St. Paul Alaska, USA

Island in the middle of the Bering Sea

Peak load of 160kW

Cost of Power, \pm \$0.21/kWh

Waste energy used for heating

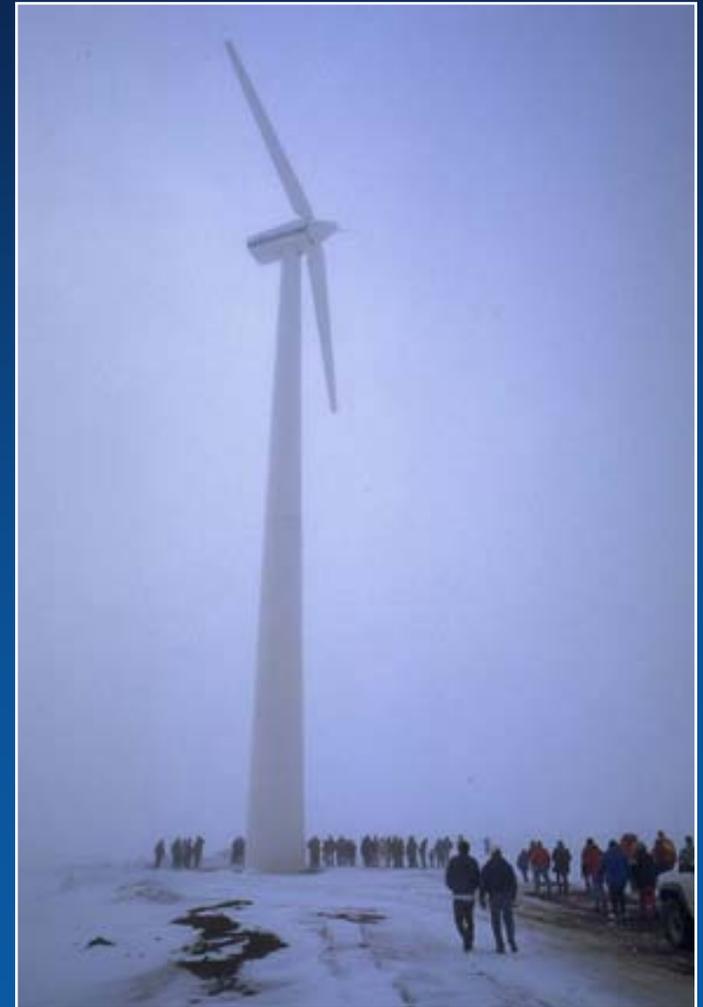

St. Paul Power System

- 225 kW Wind Turbine
- 2 x 150 kW Diesel Gensets
- Digital Engine Controls
- NPS Components
 - System Controllers/
RemoteView™
 - Synchronous Condenser
 - Heating and Thermal Plant
 - Integrated Shelter
 - Dump Load Regulator



Key Points of Large Hybrid Systems

- Differences in Energy Storage
 - Long term energy storage: Larger battery bank to transfer energy from one time to another. Order of hours.
 - Short term energy storage: Energy used for very short periods to provide grid stability and allow controlled diesel engine starting. Order of minutes.
- Power Quality issues
- System Control
 - DSP based advanced control is required

Power Balancing Alternatives

- **Control wind generation:** mechanical pitch control, electronic control, individual machine switching in multiple machine windfarms.
- **Dispatchable Loads:** Installations of controllable incremental loads like resistance heating to consume extra power.
- **Load shedding** where non-critical loads are temporarily shut off to quickly reduce system load.

Conclusions

- Many options for the configuration of hybrid systems - Depend on load, resource, and costs.
- Medium penetration wind-diesel systems are operating in various isolated locations around the world. Instantaneous wind penetration levels exceeding 50% of load are common.
- Several high penetration systems, with and without energy storage, have been successfully demonstrated.
- High penetration systems are capable of prolonged diesel-off operation.

Village Power Hybrids

Simulation Models for Options Analysis

